


VALE CONSULTANCY
21690 - SK01
MASS BLOCK RETAINING WALL
INDICATIVE SECTION VIEW
NOT TO SCALE

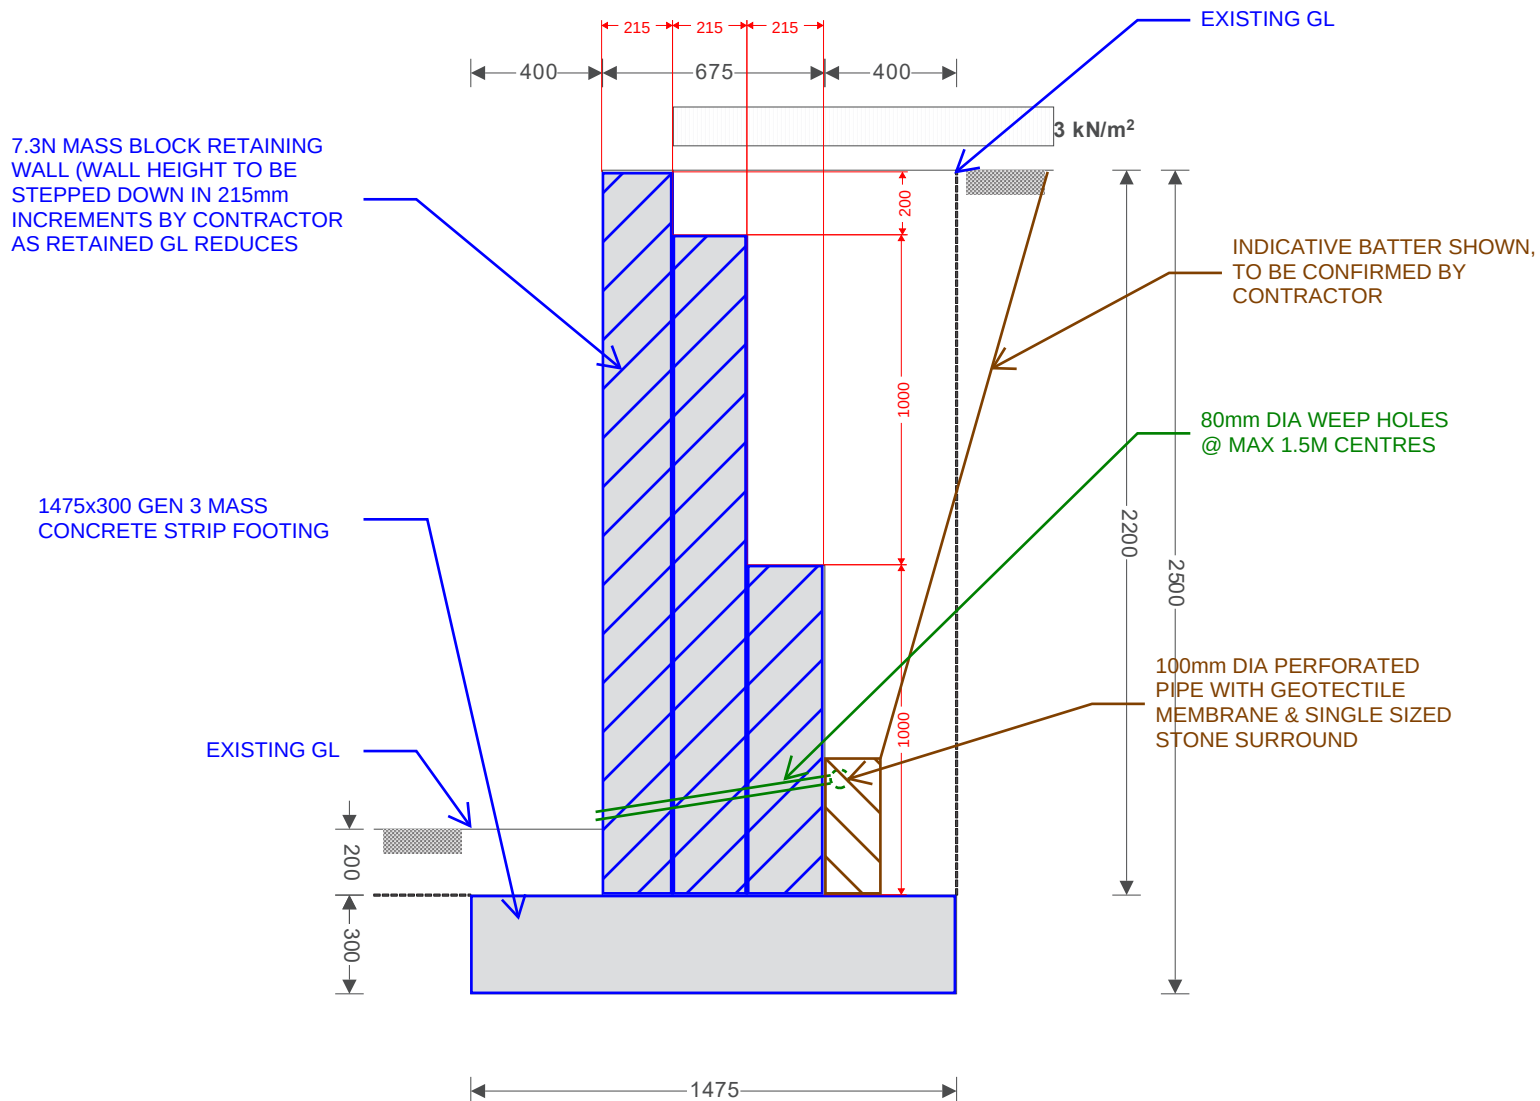

NOTES:

- PROPOSED BLOCKWORK TO BE MINIMUM 7.3N COMPRESSIVE STRENGTH OR GREATER
- BACKFILL WITH TYPE 1 GRANULAR MATERIAL TO ALLOW FREE DRAINAGE, TO BE COMPACTED IN 300mm LAYERS
- WEEPHOLES TO BE @ MAX 1.5m CENTRES (OR CLOSER IF PREFERRED)
- FORMATION LEVEL OF BASE TO BE IN DENSE GRAVELLY STRATA, TO BE CONFIRMED BY CONTRACTOR UPON EXCAVATION
- BASE TO BE FORMED IN MIN GEN 3 MASS CONCRETE OR BETTER, TO BE CONFIRMED BY CONTRACTOR PRIOR TO WORKS AS NECESSARY
- ALLOWABLE GROUND BEARING PRESSURE ASSUMED MINIMUM 100kPa OR GREATER, TO BE CONFIRMED BY CONTRACTOR/SI REPORT BY CLIENT PRIOR TO WORKS.